

Low voltage

High-voltage zone

Building and services

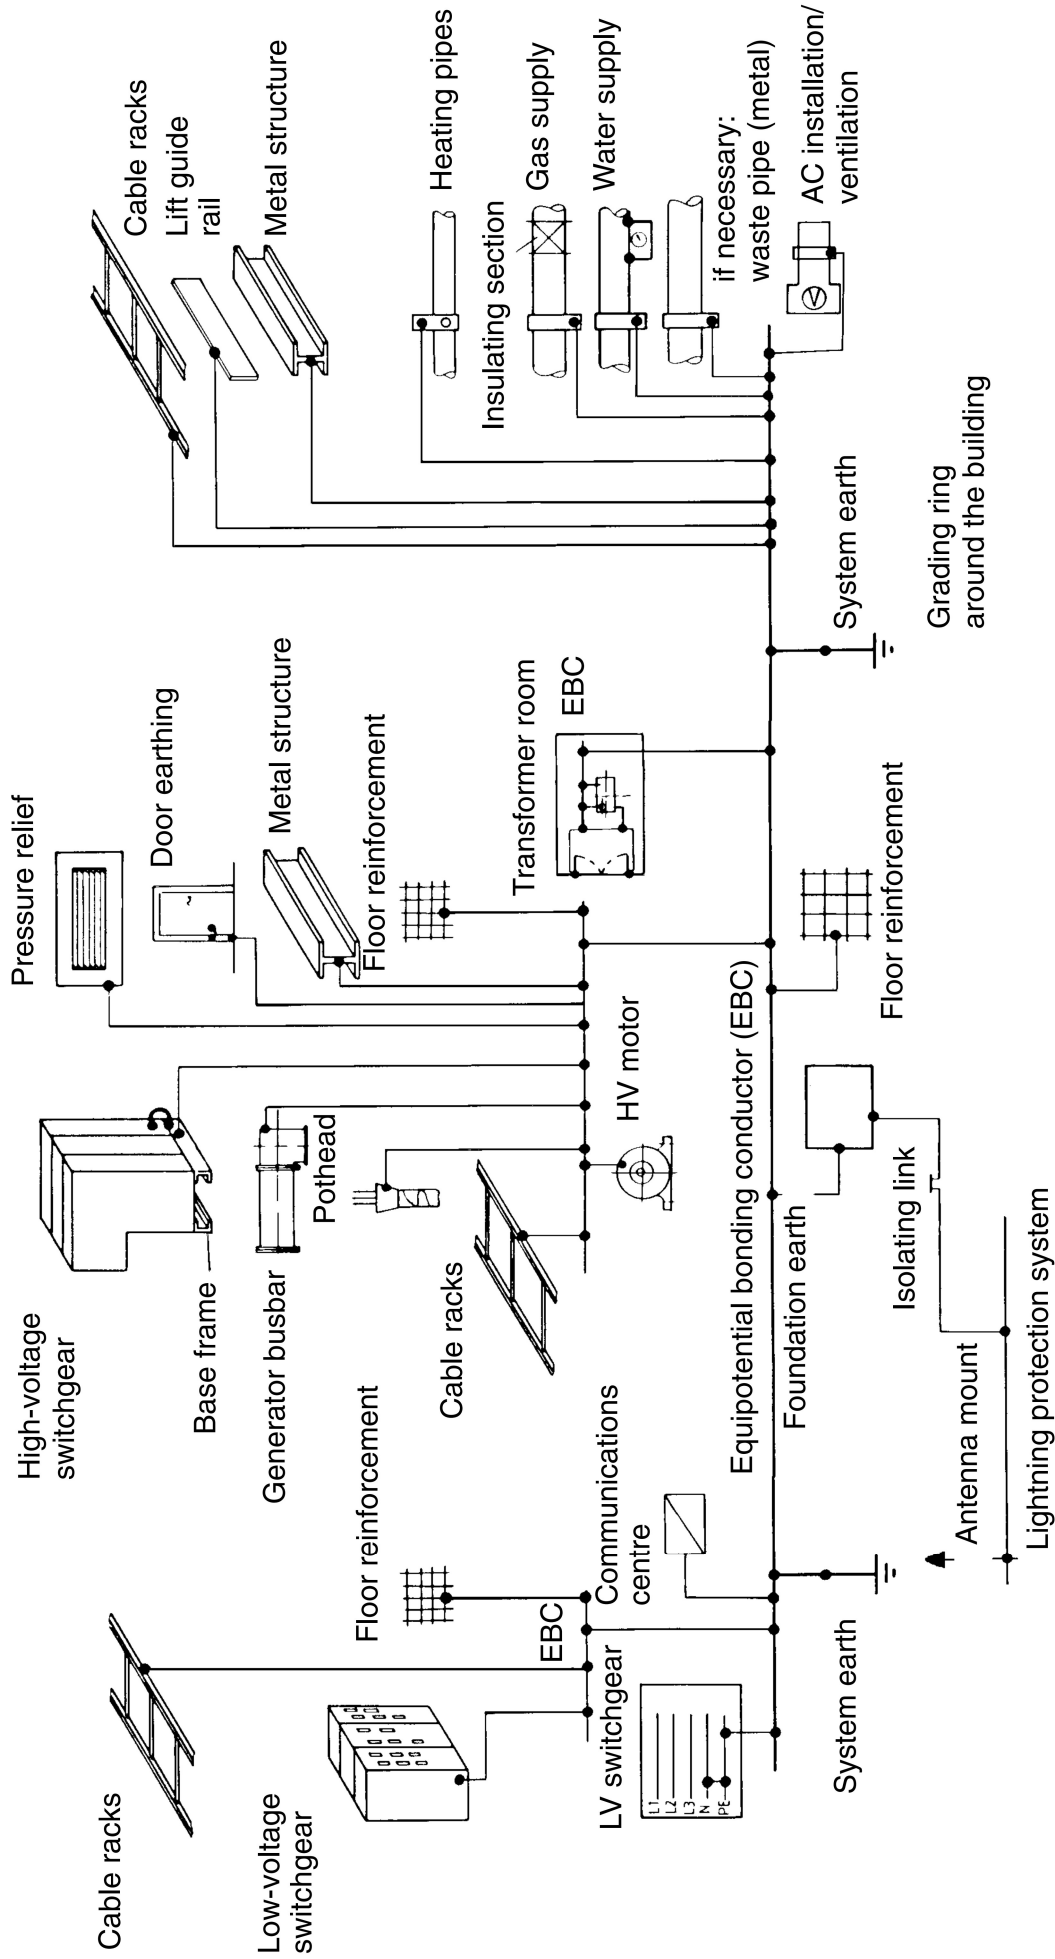


Fig. 5-8

Earthing system with equipotential bonding between HV/LV indoor switchgear and building/building services